


AWWA C-502 FIRE HYDRANT W/1 4-1/2" PUMPER NOZZLE A 2 2-1/2" HOSE NOZZLES AND 5-1/4" MAIN VALVE. MUELLER SUPER CENTURION 200 ONLY.

NOTES:

1. ALL WORK MUST BE INSPECTED PRIOR TO BACKFILL
2. COORDINATE WORK W/FIRE DISTRICT 435-649-6706
3. FIRE HYDRANT SHALL STAND PLUMB WITH THE PUMPER NOZZLE FACING THE STREET.
4. PAINTING: ALL BURIED PORTIONS OF THE HYDRANT SHALL BE PAINTED WITH TWO COATS OF CA50 COAL TAR ENAMEL. EXPOSED PORTIONS SHALL BE PAINTED WITH TWO COATS OF BAKELLITE-BASE PAINT WITH TUNG OIL THINNER, TROPICAL INDUSTRIAL ENAMELS OR APPROVED EQUAL: PRIMER COAT, ACB PRIMER #525-14 FINISH COAT, VERMILLION RED #887-04; PHINAMEL, EXCEPT THAT CAPS SHALL BE BLACK, PHINAMEL #887-02.
5. CONTRACTOR TO PROVIDE PERMANENT FIRE HYDRANT MARKER.

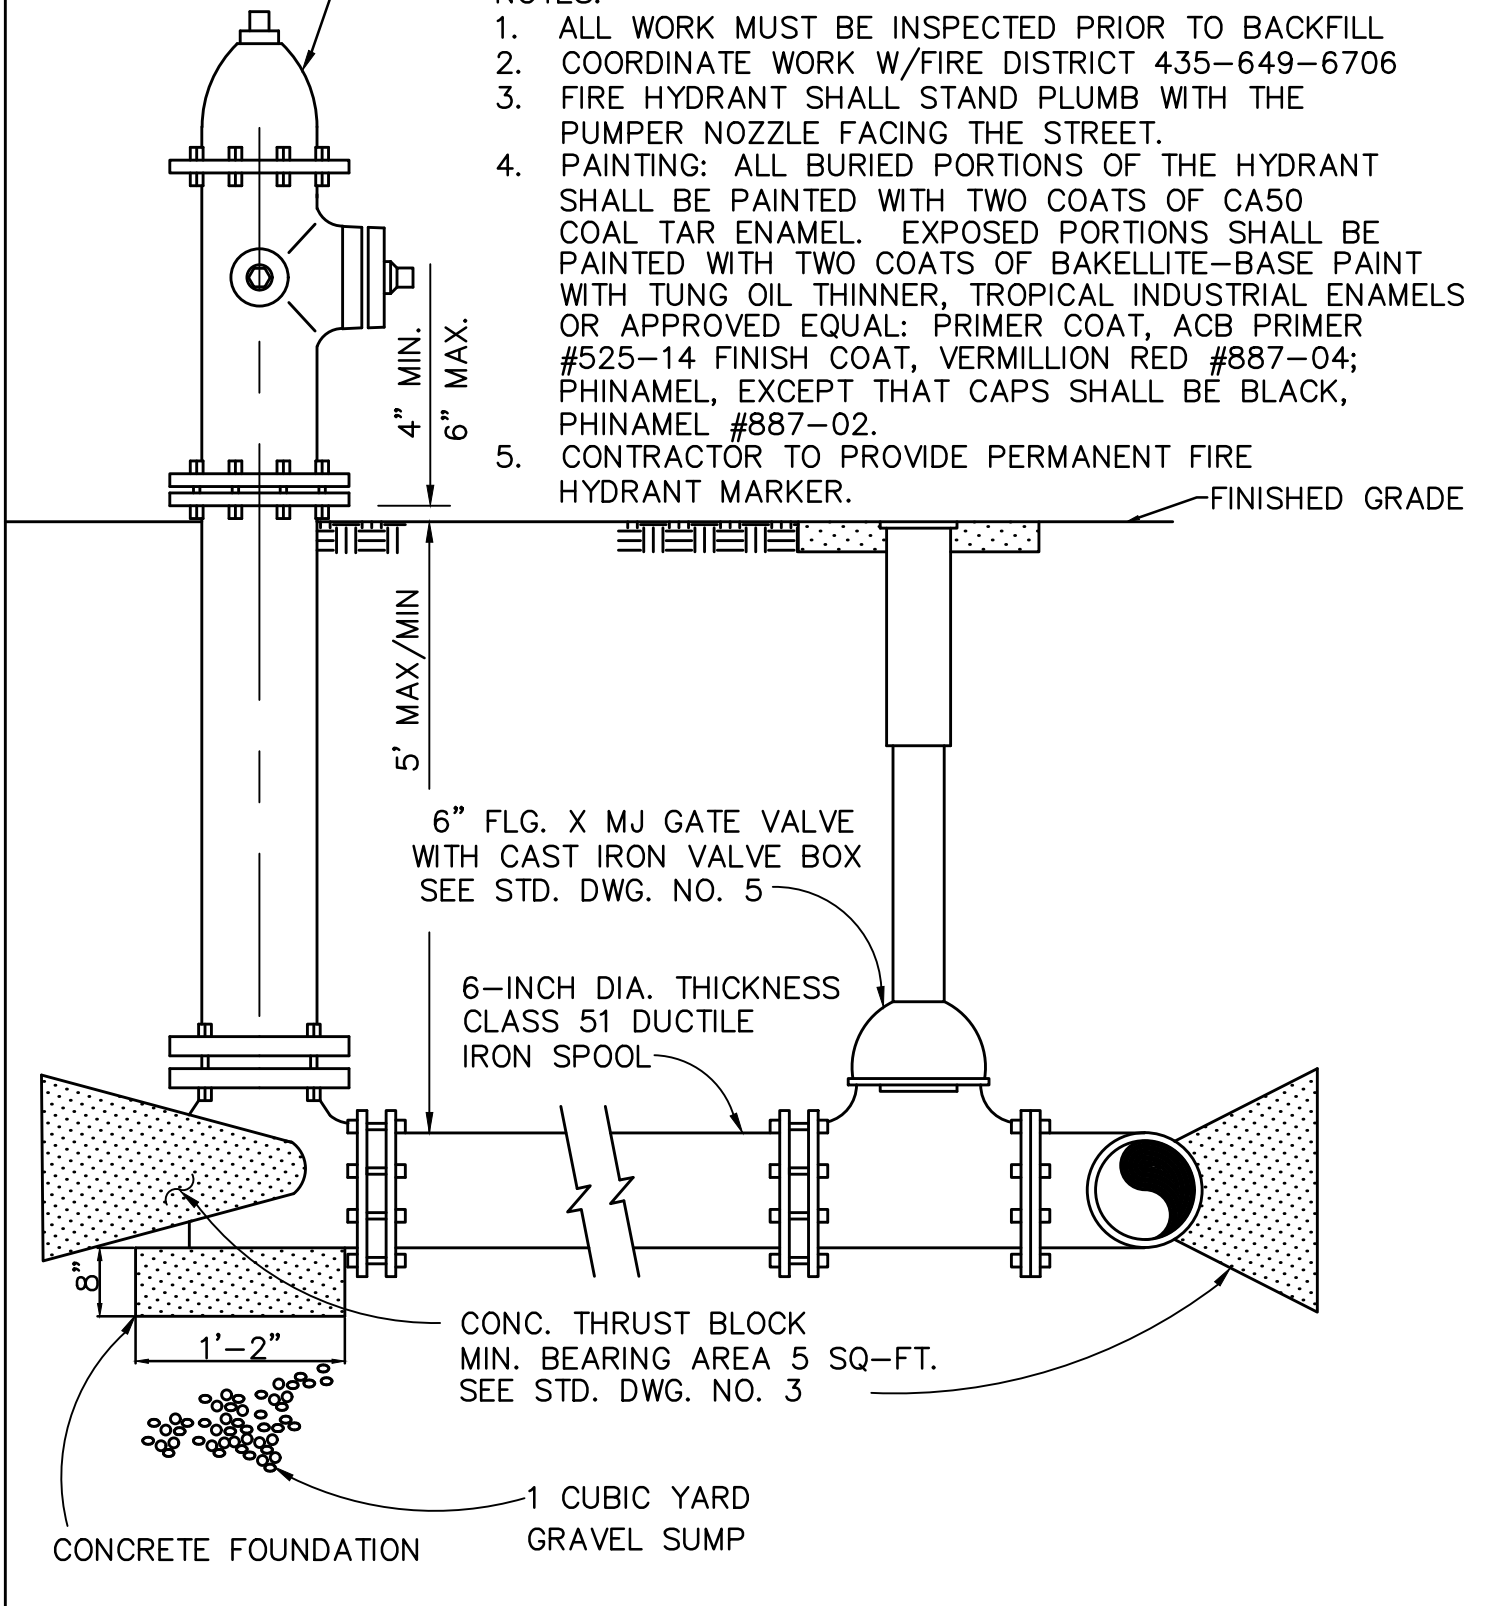

REV. NO.	PREPARED BY:	SUMMIT WATER DISTRIBUTION CO.	STANDARD DWG. NO.
1. 9/11/97 2. 10/6/00 3. 11/8/07 4. 12/31/15	 <b>Bowen Collins &amp; Associates, Inc.</b> CONSULTING ENGINEERS	<h1>FIRE HYDRANT DETAIL</h1>	<h1>4</h1>